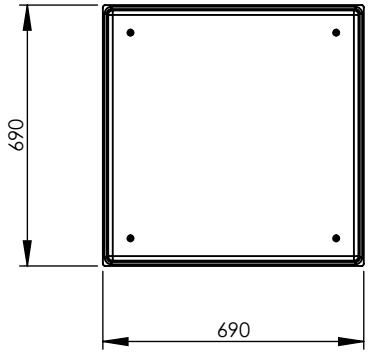

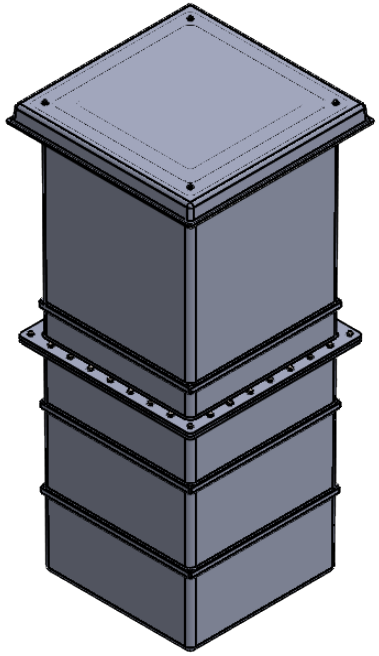

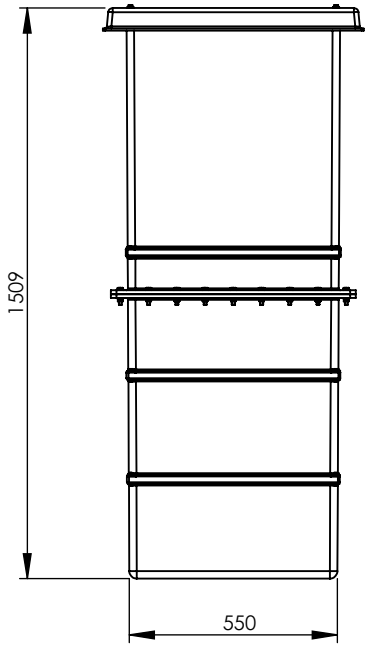

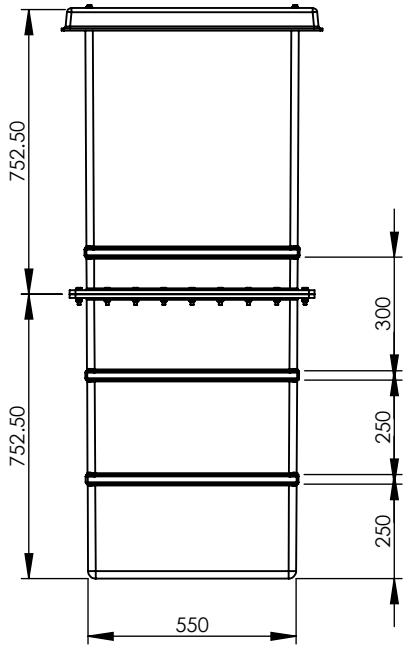

TITLE: PW375.INS-2.AG	NOTE: All tanks must be fully supported on a flat,level & continuous foundation providing structural support to the tank when full to maximum operating capacity.It is essential that the user refers to the conditions of installation document prior to the installation of the tank.Under no circumstances should the tank body be used to provide support to pipework and ancillary items. The tank lid is a structural part of the tank and must be in place and fitted correctly when water is contained within the tank.	DESCRIPTION: PW375-2 piece cold water storage tank suitable for AG/AF Air gap	DATE: 05/10/2017	VERSION: A	NOTES: FIRST ISSUE
DRAWN BY: C.MORRIS	DATE: 07/12/2017				
CUSTOMER: CUSTOMER	ALL DIMENSIONS+/- 5mm UNLESS OTHERWISE STATED	A4	ALL DIMENSIONS IN MM - DO NOT SCALE		

TANK SPECIFICATION :	
INTERNAL DIMENSIONS	500 x 500 x 1500mm
EXTERNAL DIMENSIONS	690 x 690 x 1509mm
NOM. CAPACITY	375 Litres
DRY WEIGHT	30 KG
INSULATION THICKNESS	25mm
WRAS CERT. NUMBER	131006
MATERIAL	GRP

tanks.ie

SCALE:1:20 | SHEET 1 OF 1