



Fabrication Specifications				
ITEM	INDEX	DEPTH (mm)	DIA. (mm)	CLOCKFACE POSITION
Tank depth	A	1000	-	
Tank Ø	B	-	1000	
Inlet	C1		110	
Inlet	C2			
Inlet	C3			
Discharge	D		63	12
Cable duct			110	
Vent			110	

**PLEASE NOTE THAT THIS DOCUMENT MUST BE READ IN CONJUNCTION WITH THE INSTALLATION & OPERATING GUIDELINES**

**Comments**

Please Note - Inlet invert should be between 400 - 515 mm.

Inlet seals and ducts can be supplied loose to be drilled and fitted on site

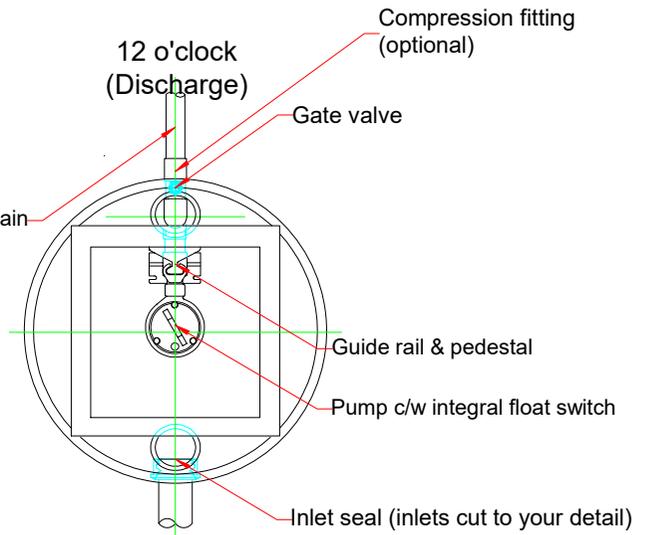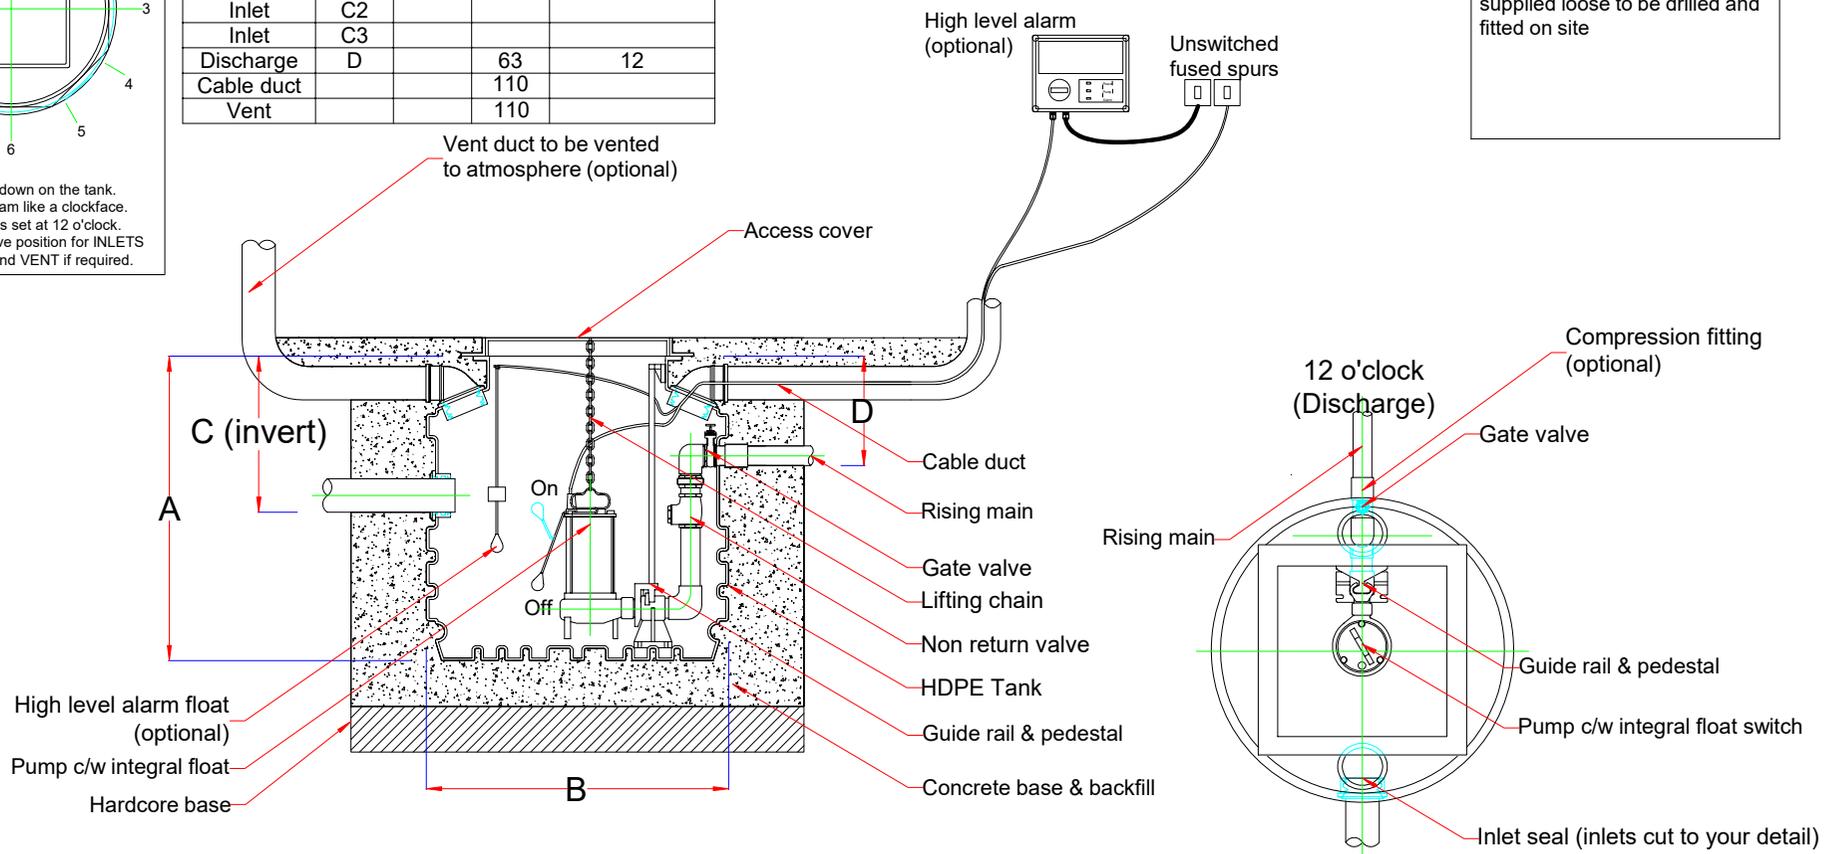

REV	DETAIL	DATE	DRAWN

TITLE  
Single rigged Ø1000 x 1000 mm typical layout

CUSTOMER

DRAWING NO DPT111128	DATE 09/11/2018	DRAWN gf
THIRD ANGLE PROJECTION		SCALE NOT TO SCALE
		SHEET 1 of 1
TOLERANCE +/- 2%		REV 0