



| Fabrication Specifications | | | | |
|----------------------------|-------|------------|-----------|--------------------|
| ITEM | INDEX | DEPTH (mm) | DIA. (mm) | CLOCKFACE POSITION |
| Tank depth | A | 2500 | - | - |
| Tank Ø | B | - | 1200 | - |
| Inlet | C1 | | 110 | |
| Inlet | C2 | | | |
| Inlet | C3 | | | |
| Discharge | D | | 63 | |
| Cable duct | | | 110 | |
| Vent | | | 110 | |



View looking down on the tank. Treat this diagram like a clockface. DISCHARGE is set at 12 o'clock. Indicate the relative position for INLETS, CABLE DUCT and VENT if required.

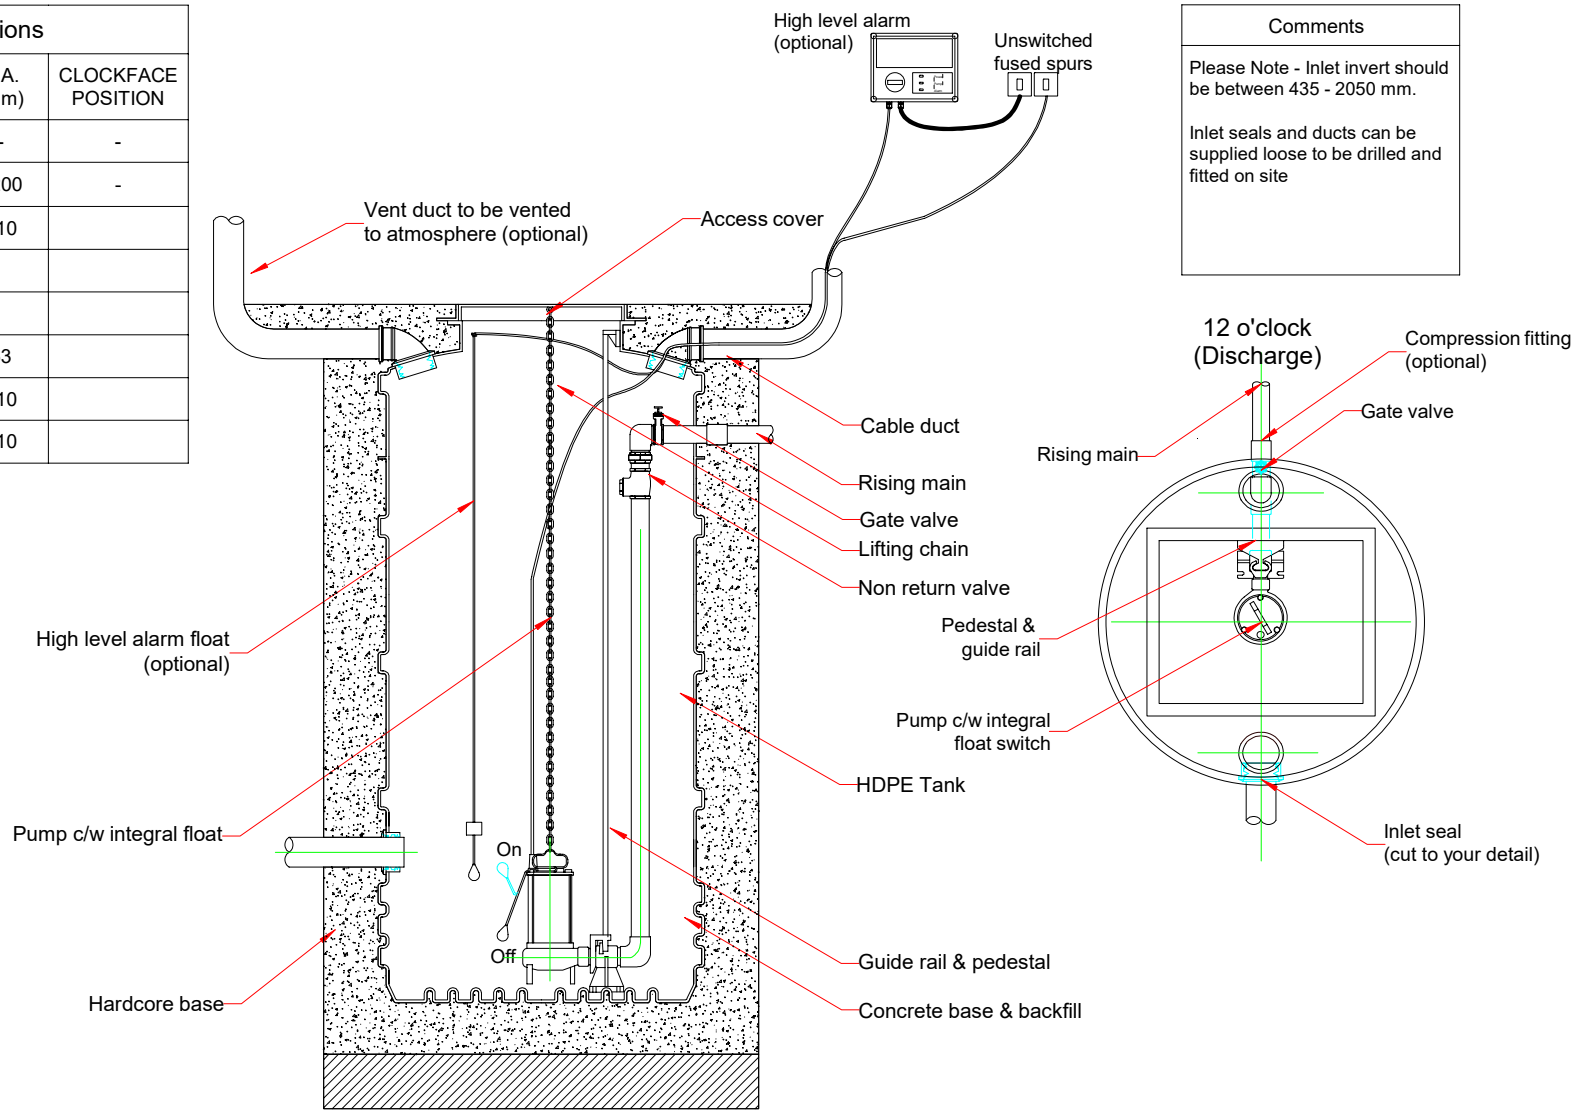

Comments

Please Note - Inlet invert should be between 435 - 2050 mm.

Inlet seals and ducts can be supplied loose to be drilled and fitted on site

PLEASE NOTE THAT THIS DOCUMENT MUST BE READ IN CONJUNCTION WITH THE INSTALLATION & OPERATING GUIDELINES

| REV | DETAIL | DATE | DRAWN |
|-----|--------|------|-------|
| | | | |
| | | | |
| | | | |

TITLE

**Single rigged
Ø1200 x 2500 mm
typical layout**

| | | |
|------------------------|------------|--------------|
| DRAWING NO | DATE | DRAWN |
| DPT112108 | 05/12/2018 | gf |
| THIRD ANGLE PROJECTION | | SCALE |
| | | NOT TO SCALE |
| TOLERANCE +/- 2% | | SHEET |
| | | 1 of 1 |
| REV | 0 | |

CUSTOMER