



# Drawing Not To Scale

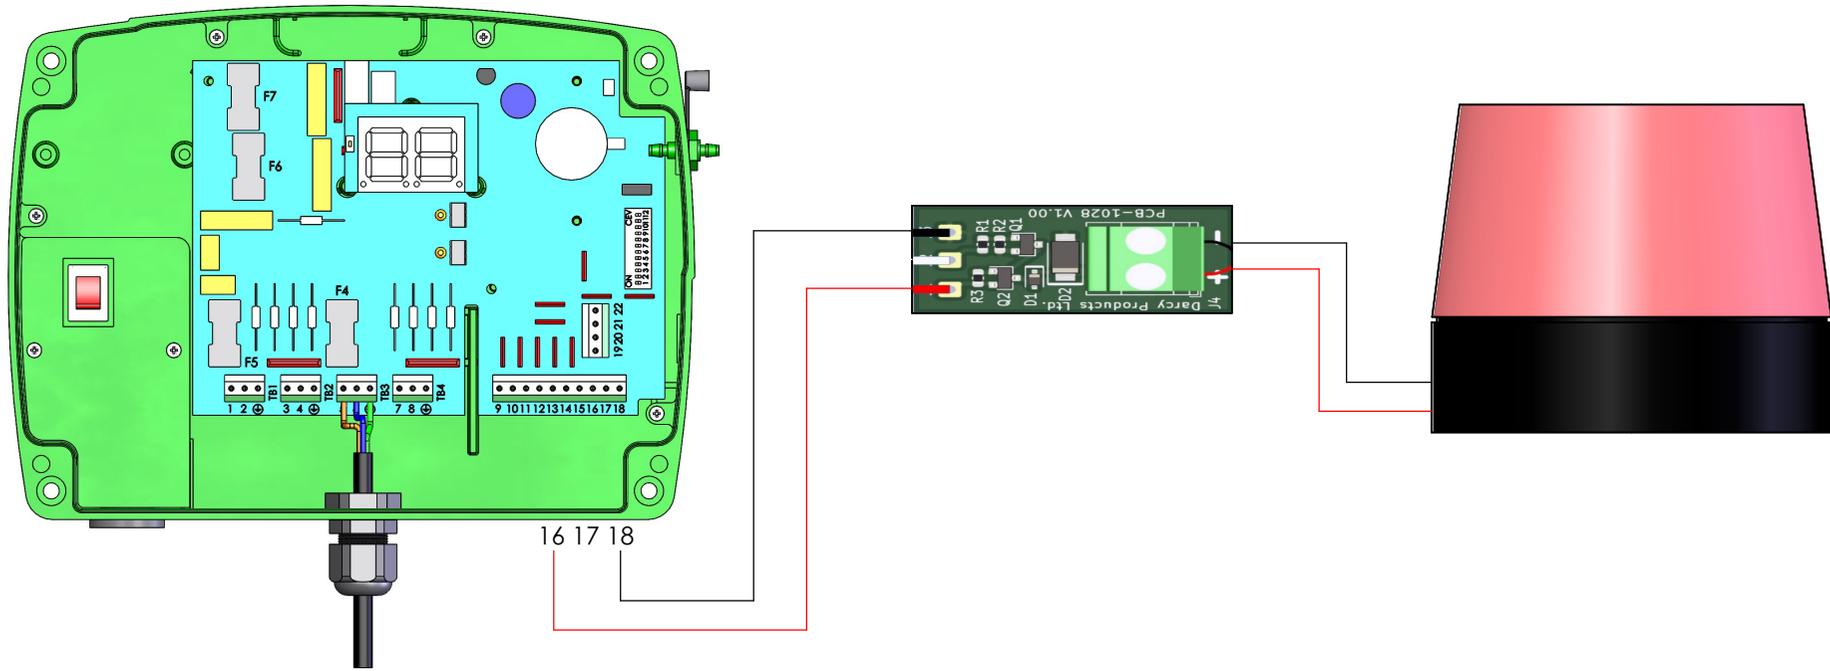

## NOTE:

1. 1012504 is an Adaptor to be used to connect 1009254 Beacon to 010086 Panel
2. Connect Red, White and Black Cable to Terminal 16, 17 & 18 of 010086 respectively
3. Connect Red (+) and Black (-) cables from the beacon into the terminal on Adaptor
4. Place the Adaptor inside the panel, in front of the PCB as shown on right.
5. Close the Protective Plate and Lid of panel.

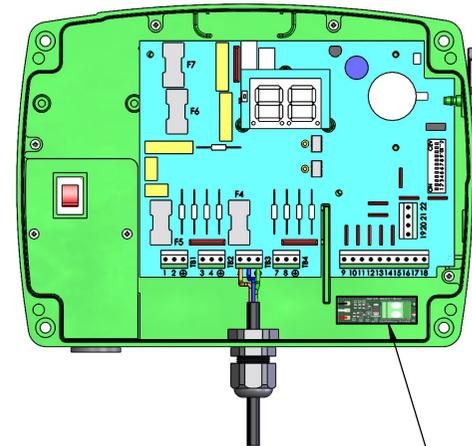

1012504 Adaptor to be placed inside the panel

Please check with Kingspan Water & Energy for the latest Issue of the drawing

Issue	Date	Drawn By	Approved By	Description
A	13/01/2023	Viaasan K		Initial Issue

LN Number :  
Finish :  
Weight : 0.00 Kg  
Modelled By :

Tolerance (unless stated) : +/- 1mm  
Thickness :  
Surface Area : m<sup>2</sup>  
Material : Material <not specified>


**Drawing : 1012551**

Page 1 of 1

**Adaptor & Beacon Kit for 010086 Panel**

All Dimensions In mm

Scale: Do Not Scale



Third Angle Projection

Kingspan Water & Energy reserve the right to alter the details of this drawing without prior notice. This drawing is copyright and may not be reproduced or used without the written permission of Kingspan Water & Energy

